





Solenoid Valve Timer 720 Series

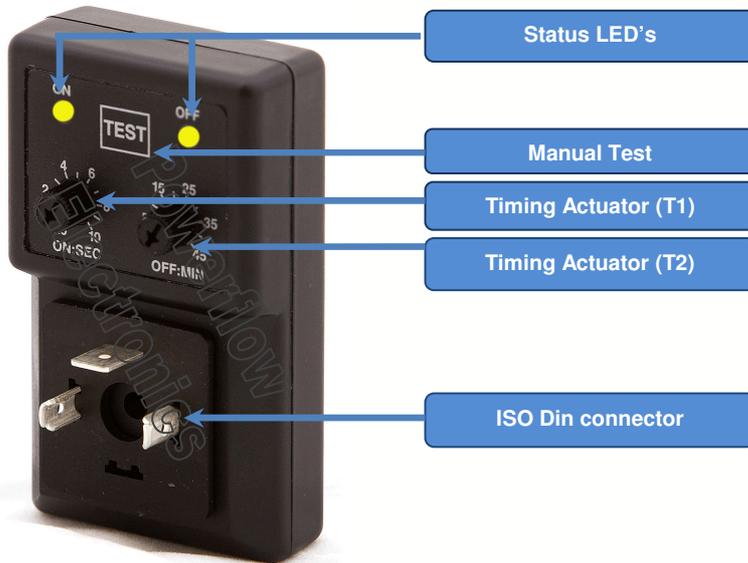

Repeat Cycle Timer

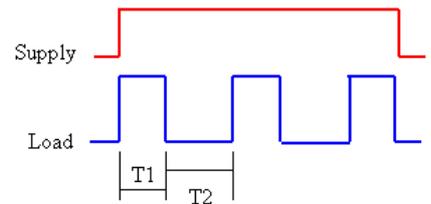


Upon application of power the timer resets, enters the ON state for a period T1, then switches OFF for a period T2. This cycle repeats until power is removed.

Applications

- ◆ Sampling gas or Liquids
- ◆ Air dryers
- ◆ Effluent sampling
- ◆ Sprinkler systems
- ◆ Auto drain valve: automatic discharge of condensate
- ◆ Pneumatic vibration systems (e.g. Powder silos)
- ◆ Automatic lubrication systems
- ◆ Dosing systems

Technical Specification

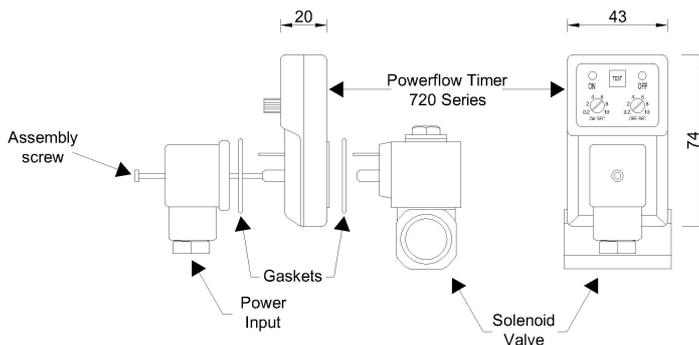


Every effort has been taken to ensure the accuracy of this specification. However in order to maintain our technological lead we are continuously improving our products which could, without notice result in amendments or omissions to this specification. We cannot accept responsibility for damage, injury, loss or expenses resulting therein.

Specification				
Timing Scale	T1 Time	Model Specific	T2 Time	Model Specific
Supply Voltage	24-240V AC/DC 50/60Hz or 12-24V DC (Standard)		Other supply voltages available on request	
Current Consumption	4mA Max.	Timing Temp. Coefficient	+ or - 0.005% °C	
Operating Temp.	-10 to +60°C	Scale Accuracy	+ or -10%	
Environmental Protection	IP65, NEMA IV	Reset/ Test	Manual Touch Switch	
Switch Capacity	1 Amp.	Printed Circuit Board	UL 94V0	
Inrush Current	10 Amps for 10mSec	Repeat Accuracy	+ or - 1%	
Switching Holding Voltage	400V	Indicators	LED's to indicate phases	
Duty Cycles	100%	Design Standard	VDE 0110C	
Input	DIN 46350-A / ISO 4400	Output	DIN 46350-A / ISO 4400 Dual Earth (0/6)	
Supplied	Flat Gasket & screw	Optional Extras	Screws / Connectors / Power Cords	




International Organization for Standardization






Solenoid Valve Timer 720 Series


Standard Repeat Cycle Timer Part Numbers		
Part Number	T1 Time	T2 Time
720-01-026	0.02 - 0.30Sec.	0.5 - 60Min
720-01-205	0.02 - 3Sec.	0.5 - 45Min
720-01-014	0.5 - 10Sec.	0.5 - 10Sec.
720-01-028	0.5 - 10Sec.	0.5 - 60Sec.
720-01-061	0.5 - 10Sec.	0.5 - 60Sec.
720-01-206	0.5 - 10Sec.	12 - 180Sec
720-01-207	0.5 - 10Sec.	0.5 - 5Min
720-01-114	0.5 - 10Sec.	0.2 - 15Min
720-01-208	0.5 - 10Sec.	0.2 - 20Min
720-01-209	0.5 - 10Sec.	0.5 - 30Min
720-01-000	0.5 - 10Sec.	0.5 - 45Min
720-01-042	0.5 - 10Sec.	1 - 130Min
720-01-028	0.5 - 10Sec.	0.5 - 24Hrs
720-01-210	0.5 - 15Sec.	0.1 - 5Min.
720-01-049	0.5 - 15Sec.	0.1 - 6Hrs
720-01-032	0.5 - 20Sec.	0.5 - 45Min
720-01-082	0.3 - 30Sec.	0.5 - 45Min
720-01-211	2 - 40Sec.	0.5 - 45Min
720-01-204	0.5 - 60Sec.	0.5 - 60Sec.
720-01-013	5 - 120Sec.	0.5 - 45Min
720-01-212	0.5 - 5Min.	0.5 - 5Min.
720-01-068	0.3 - 5Min.	1 - 60Min
720-01-200	0.5 - 10Min.	0.5 - 60Min
720-01-074	0.5 - 30Min.	1 - 10Sec.
720-01-213	0.5 - 45Min.	0.5 - 10Sec.
720-01-135	1 - 60Min.	1 - 60Min
720-01-106	120Sec.	120Sec
720-01-220	0.5 - 60Sec.	24Hrs
720-01-221	0.1 - 120Sec.	12Min.
<p>Other timings available on request: <i>msec, sec, mins, hrs, days, weeks, months</i> Fixed timings available Memory backup option Standard Colour: Black Other colours available</p>		



Solenoid Valve Timer 790 Series

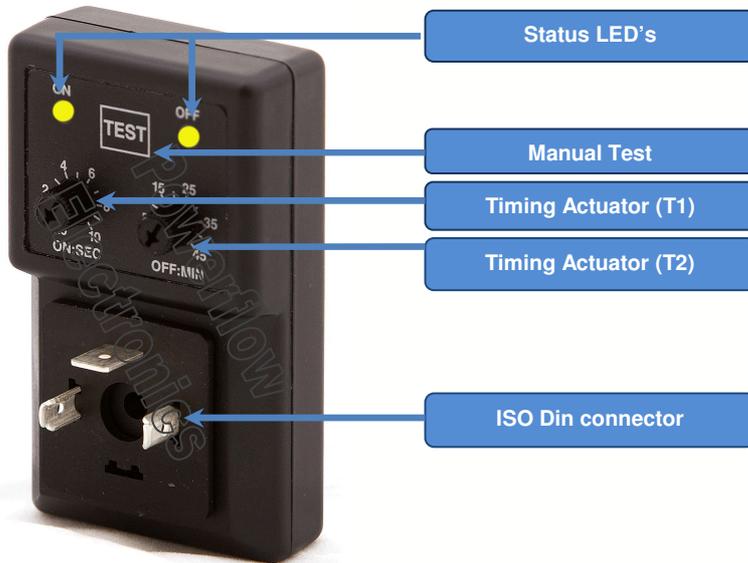

Repeat Cycle Timer

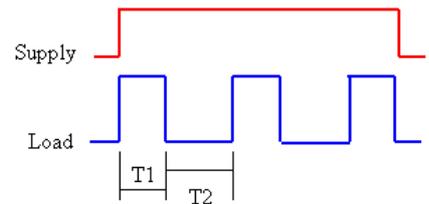


Upon application of power the timer resets, enters the ON state for a period T1, then switches OFF for a period T2. This cycle repeats until power is removed.

Applications

- ◆ Sampling gas or Liquids
- ◆ Air dryers
- ◆ Effluent sampling
- ◆ Sprinkler systems
- ◆ Auto drain valve: automatic discharge of condensate
- ◆ Pneumatic vibration systems (e.g. Powder silos)
- ◆ Automatic lubrication systems
- ◆ Dosing systems

Technical Specification

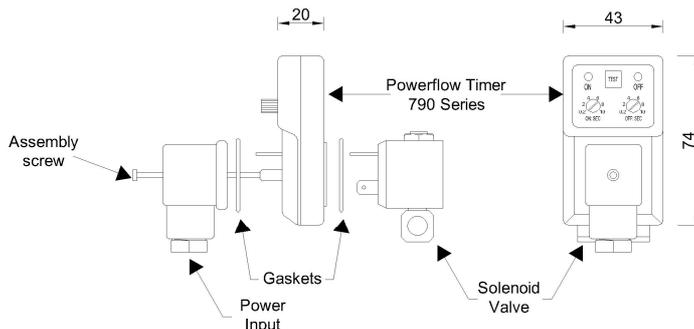


Every effort has been taken to ensure the accuracy of this specification. However in order to maintain our technological lead we are continuously improving our products which could, without notice result in amendments or omissions to this specification. We cannot accept responsibility for damage, injury, loss or expenses resulting therein.

Specification				
Timing Scale	T1 Time	Model Specific	T2 Time	Model Specific
Supply Voltage	24-240V AC/DC 50/60Hz (Standard)		Other supply voltages available on request	
Current Consumption	4mA Max.		Timing Temp. Coefficient	+ or - 0.005% °C
Operating Temp.	-10 to +60°C		Scale Accuracy	+ or -10%
Environmental Protection	IP65, NEMA IV		Reset/ Test	Manual Touch Switch
Switch Capacity	1 Amp.		Printed Circuit Board	UL 94V0
Inrush Current	10 Amps for 10mSec		Repeat Accuracy	+ or - 1%
Switching Holding Voltage	400V		Indicators	LED's to indicate phases
Duty Cycles	100%		Design Standard	VDE 0110C
Input	DIN 46350-A / ISO 4400		Output	DIN 46350-B / ISO 6952
Supplied	Flat Gasket & 50mm screw		Optional Extras	Screws / Connectors / Power Cords



International Organization for Standardization





Solenoid Valve Timer

790 Series

Repeat Cycle Timer <u>Earth at 0</u>		
Part Number	T1 Time	T2 Time
790-01-171	0.02 – 0.30Sec.	0.5 – 60Min.
790-01-169	0.02 – 3Sec.	0.5 – 45Min.
790-01-157	0.5 – 10Sec.	0.5 – 10Sec.
790-01-213	0.5 – 10Sec.	0.5 – 60Sec.
790-01-166	0.5 – 10Sec.	0.5 – 60Sec.
790-01-160	0.5 – 10Sec.	12 – 180Sec.
790-01-155	0.5 – 10Sec.	0.5 – 5Min.
790-01-158	0.5 – 10Sec.	0.2 – 15Min.
790-01-161	0.5 – 10Sec.	0.2 – 20Min.
790-01-168	0.5 – 10Sec.	0.5 – 30Min.
790-01-000	0.5 – 10Sec.	0.5 – 45Min.
790-01-164	0.5 – 10Sec.	1 – 130Min.
790-01-172	0.5 – 10Sec.	0.5 – 24Hrs.
790-01-173	0.5 – 10Sec.	0.1 – 5Min.
790-01-174	0.5 – 15Sec.	0.1 – 6Hrs.
790-01-163	0.5 – 20Sec.	0.5 – 45Min.
790-01-162	0.3 – 30Sec.	0.5 – 45Min.
790-01-037	2 – 40Sec.	0.5 – 45Min.
790-01-177	0.5 – 60Sec.	0.5 – 60Sec.
790-01-184	0.5 – 60Sec.	24Hrs.
790-01-176	5 – 120Sec.	0.5 – 45Min.
790-01-165	0.5 – 5Min.	0.5 – 5Min.
790-01-178	0.3 – 5Min.	1 – 60 Min.
790-01-029	0.5 – 10Min.	0.5 – 60Min.
790-01-175	0.5 – 30Min.	1 – 10Sec.
790-01-170	0.5 – 45Min.	0.5 – 10Sec.
790-01-179	1 – 60Min.	1 – 60Min.
790-01-185	0.1 – 120Sec.	12Min.
790-01-159	120Sec.	120Sec.
Repeat Cycle Timer <u>Earth at 6</u>		
Part Number	T1 Time	T2 Time
790-01-196	0.02 – 0.30Sec.	0.5 – 60Min.
790-01-194	0.02 – 3Sec.	0.5 – 45Min.
790-01-021	0.5 – 10Sec.	0.5 – 10Sec.
790-01-214	0.5 – 10Sec.	0.5 – 60Sec.
790-01-191	0.5 – 10Sec.	0.5 – 60Sec.
790-01-041	0.5 – 10Sec.	12 – 180Sec.
790-01-045	0.5 – 10Sec.	0.5 – 5Min.
790-01-031	0.5 – 10Sec.	0.2 – 15Min.
790-01-186	0.5 – 10Sec.	0.2 – 20Min.
790-01-193	0.5 – 10Sec.	0.5 – 30Min.
790-01-004	0.5 – 10Sec.	0.5 – 45Min.
790-01-189	0.5 – 10Sec.	1 – 130Min.
790-01-197	0.5 – 10Sec.	0.5 – 24Hrs.
790-01-198	0.5 – 10Sec.	0.1 – 5Min.
790-01-199	0.5 – 15Sec.	0.1 – 6Hrs.
790-01-188	0.5 – 20Sec.	0.5 – 45Min.
790-01-187	0.3 – 30Sec.	0.5 – 45Min.
790-01-017	2 – 40Sec.	0.5 – 45Min.
790-01-202	0.5 – 60Sec.	0.5 – 60Sec.
790-01-201	0.5 – 60Sec.	24Hrs.
790-01-190	5 – 120Sec.	0.5 – 45Min.
790-01-203	0.5 – 5Min.	0.5 – 5Min.
790-01-156	0.3 – 5Min.	1 – 60 Min.
790-01-200	0.5 – 10Min.	0.5 – 60Min.
790-01-195	0.5 – 30Min.	1 – 10Sec.
790-01-204	0.5 – 45Min.	0.5 – 10Sec.
790-01-040	1 – 60Min.	1 – 60Min.
790-01-209	0.1 – 120Sec.	12Min.
790-01-210	120Sec.	120Sec.

Other timings available on request:
msec, sec, mins, hrs, days, weeks, months
Fixed timings available
Memory backup option
Any colour